

TERRA-MATER FLOORS PTY LTD

TEST REPORT

SCOPE OF WORK

Australian Timber Flooring

REPORT NUMBER

260915015SHF-002

TEST DATE(S)

2026-09-15 - 2026-10-08

ORIGINAL ISSUE DATE

2026-10-08

PAGES


5

DOCUMENT CONTROL NUMBER

LFT-APAC-SHF-OP-10k(September 01, 2026)

© 2026 INTERTEK

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch

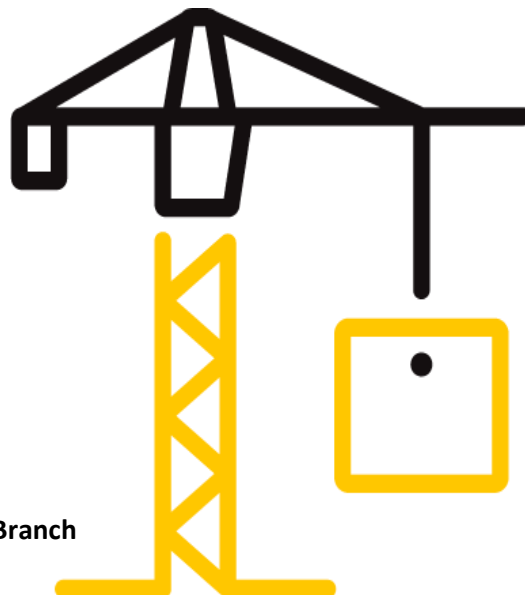

Test Report

Statement

- 1.This report is invalid without company's special seal for testing on the assigned page.
- 2.This report is invalid without an authorized person's signature.
- 3.This report is invalid if altered.
- 4.Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Partial reproduction of this report is prohibited without our written official approval. Any reproduced copy without reaffixing our test special seal shall be deemed invalid.
- 5.This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.
- 6.Except for obligations, responsibilities and liabilities (if any) arising from the appropriateness and professionalism of the aforementioned testing, limited to the testing fee received, Intertek shall not bear any other obligations or liabilities.
- 7.If the Client has any questions about the test results, Intertek B&C should be informed within the storage period of the samples. The sample storage period ends 5 working days after the official report issue date. Samples of certification program are retained for the period required by the certification rules. The samples storage period shall be calculated according to the issue date of the original report in the case of quoting results and modifying reports.
- 8.Intertek B&C will service this report for the entire test record retention period. The test record retention period ends 6 years after this report original issue date. The test record retention period for certification program is 10 years. Test records and other pertinent project documentation will be retained for the entire test record retention period.
- 9.The report was digitally signed by Intertek Group PLC, China - Shanghai. Please use Adobe Acrobat Reader to verify the authenticity.



Test Report

Original Issue Date: 2026-10-08

Intertek Report No. 260915015SHF-002

Applicant: TERRA-MATER FLOORS PTY LTD

Address: 15 Rangebank Drive, Cranbourne West, VIC 3977 Australia

Attn: 1300671777

Test Type: Performance test, samples provided by the applicant.

Product Information

Product Name	Model	Specification
Australian Timber Flooring	Barrington - Matt Wire Brush	2200×190×14/3mm
Sample ID	Sample Amount	Sample Received Date
S260915015SHF.002	19 pcs	2026-09-08
Sample Description		Brand
2200×190×14mm, 610×190×14mm		TERRA-MATER

Test Methods And Standards

Test Standard	AS 4586-2013/Amdt 1-2017 Appendix A
Specification Standard	/
Test Conclusion	The samples were tested according to the above standards, and the results are shown in the following page.

Note:

1.This report does not involve sampling. The report only reflects conformity of the tested items of the samples provided by the applicant. Representativeness and authenticity of the submitted samples are responsibilities of the applicant.

Report Authorized


Name: Sally Xie Name: Mae Zhang
Title: Reviewer Title: Project Engineer

Test Report

Original Issue Date: 2026-10-08

Intertek Report No. 260915015SHF-002

Test Items, Method and Results:

Test Item: Wet Pendulum Test
 Test Method: AS 4586-2013/Amdt 1-2017 Appendix A
 Conditioning: Condition the test specimens at $(23 \pm 2)^{\circ}\text{C}$ and $(50 \pm 5)\%$ relative humidity for 48 hours
 Test Temperature: 23°C
 Slider: Slider 96
 Test Surface: Wet condition
 Test direction: 0° = parallel to length direction
 45° = angle of 45° with length direction or width direction
 90° = parallel to width direction

Test Item	Test Method	Test Result		Class
Wet pendulum test	AS 4586-2013/Amdt 1-2017 Appendix A	Direction	Pendulum SRV	P3
		0°	40	
		45°	40	
		90°	42	

Note:

1. Class based on the lowest result of three directions.
2. Test surface and directions were included in Appendix A of this report.

AS 4586 Classification of pedestrian surface materials according to the wet pendulum test


Class	Pendulum SRV	
	Slider 96	Slider 55
P5	>54	>44
P4	45-54	40-44
P3	35-44	35-39
P2	25-34	20-34
P1	12-24	<20
P0	<12	/

Test Report

Original Issue Date: 2026-10-08

Intertek Report No. 260915015SHF-002

Appendix A: Sample Received Photo

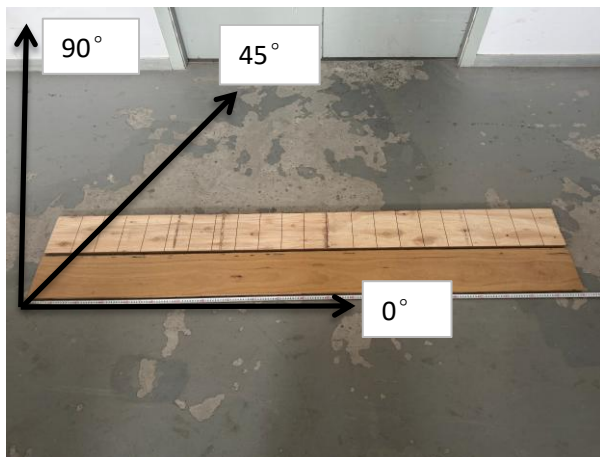

Revision:

NO.	Date	Changes
260915015SHF-002	2026-10-08	First issue